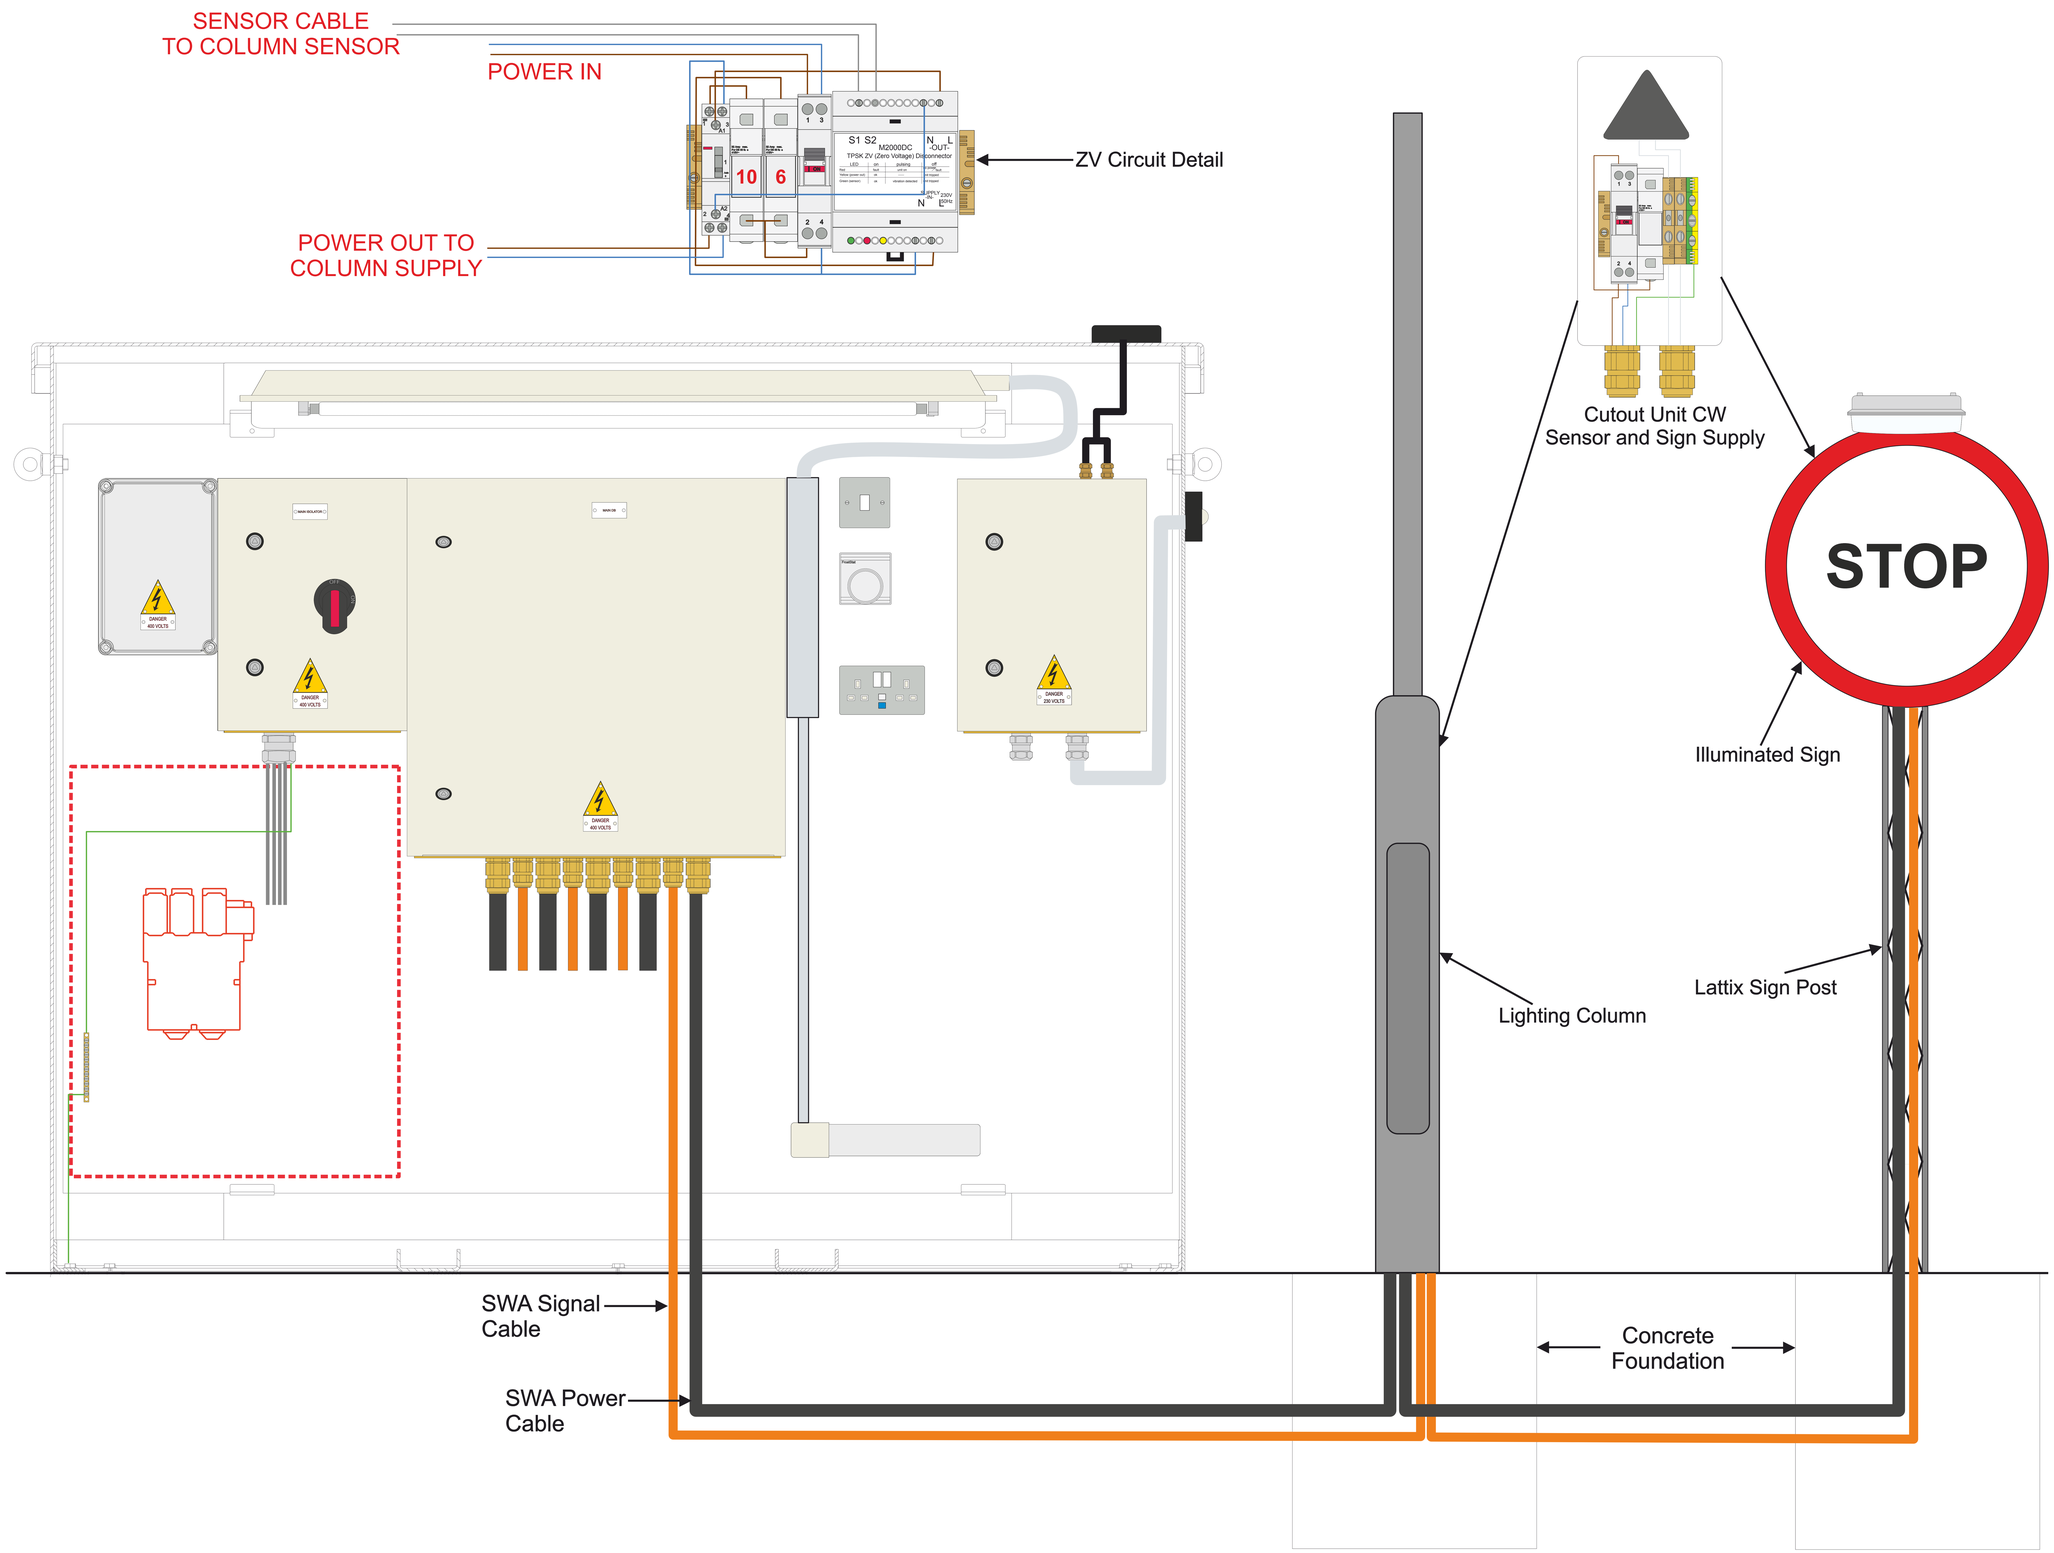

Notes:

1. Standard Tofco M2000DS Disconnection System Installed In Feeder Pillar
2. Unit Provides Circuit Discnnection in Under 0.4ms. Standard Switch Setting Enables Unit To Switch Off Monitored Structure If a Malfunction Is Detected.
3. Column/Sign Sensor Installed In Cutout Unit
4. More Than One sensor Unit Can Be Installed On Circuit

ALL ELECTRICAL WORKS ARE IN ACCORDANCE TO BS7671 (LATEST EDITION) AND ELECTRICITY AT WORK REGULATIONS.

REV	DESCRIPTION OF MODIFICATION	DATE

Tofco CPP Ltd
Meadowfield Inds Estate
Ponteland
Northumberland
NE20 9SD

01661 860001

FP PART No.
-

DRAWING TITLE:
Standard Detail M2000DC
Above Ground Passive

CLIENT DRG No.

REV.

DRAWING No.
TPSK Above Ground

SHEET	DRAWN	CHECKED	APPROVED	DATE
1 of 1	JP	JP	JP/KD	31/03/20

THIS DOCUMENT IS THE PROPERTY OF TOFCO CPP LIMITED AND IS SUPPLIED IN CONFIDENCE. IT MUST NOT BE USED FOR ANY OTHER PURPOSE OTHER THAN THAT FOR WHICH IT IS SUPPLIED, AND MUST NOT BE REPRODUCED WITHOUT PERMISSION IN WRITING FROM THE OWNER.